


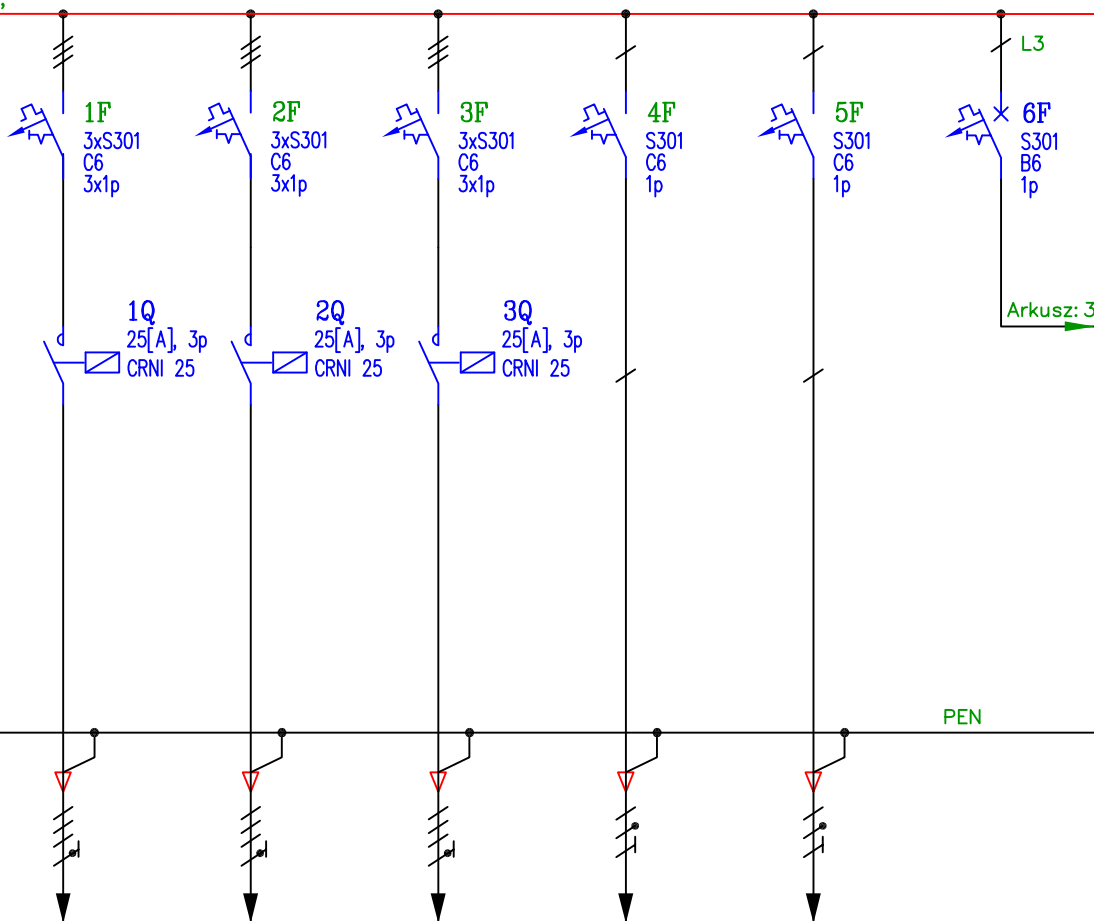

DANE OGÓLNE	TABLICZKA NR OBWODU			SO/1	SO/2	SO/3	SO/4	SO/5	SO/6	-	-	-
				1	2	3	4	5	6	-	-	-
	OPIS ODBIORNIKA			OBWÓD 1	OBWÓD 2	REZERWA -	ZASILANIE SZAFKI ZNAKÓW AKTYWNYCH SZA1	ZASILANIE SZAFKI ZNAKÓW AKTYWNYCH SZA2	STEROWANIE	-	-	-
	ILOŚĆ I TYP ODBIORNIKÓW			6x72W+2x44,5W	5x72[W]	-	1x10[W]	1x10[W]	-	-	-	-
OBŁĄCZENIE	MOC [kW]			L1	L-3f	-	-	-	-	-	-	-
				L2		-	-	-	-	-	-	-
				L3		-	-	-	-	-	-	-
				0,52[kW]			0,36[kW]	-	0,01[kW]	0,01[kW]	-	-
KABLE	NR KABLA			-	-	-	-	-	-	-	-	-
	TYP KABLA			YAKY	YAKY	-	YKY	YKY	-	-	-	-
	PRZEKRÓJ			4x25	4x25	-	3x6	3x6	-	-	-	-
	DŁUGOŚĆ			-	-	-	-	-	-	-	-	-
-												
-												
-												
-												